


DRAINAGE CURBS

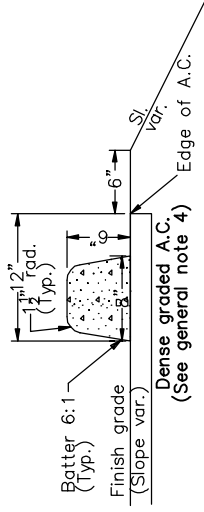

(DELETED)

DRAINAGE CURBS UNDER GUARDRAIL

GENERAL NOTES FOR ALL DETAILS:

1. For P.C. concrete drainage curbs, construct expansion joints at 200' maximum spacing, and at points of tangency.
2. For P.C. concrete drainage curbs, construct contraction joints at 15' maximum spacing.
3. Dimensions are nominal, vary to conform with curb machine approved by the engineer.
4. When bonding to dense graded A.C. pvmt., apply epoxy cement between surfaces.
5. When drainage curb is required, curb alignment shall be the same as face of guardrail, as shown above. When a run of drainage curb, or any part thereof, is placed under guardrail, curb height shall be 4".
6. For other curb types, see Std. Drg. RD700.

NOTE: This detail has been modified by the City of Winston. All material and workmanship shall be in accordance with the current Oregon Standard Specifications.

WINSTON STANDARD DRAWINGS

DRAINAGE CURBS