



ADA Curb Ramp Inspection Form

Project Name (Section)

Construction Year Contract No. Highway No. MP Cross Street Name

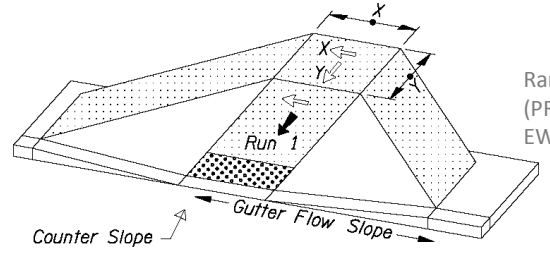


PERPENDICULAR RAMP (PR)

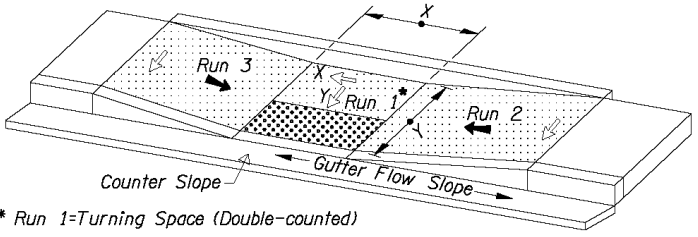

PARALLEL RAMP (PL)

* Run 1=Turning Space (Double-counted)

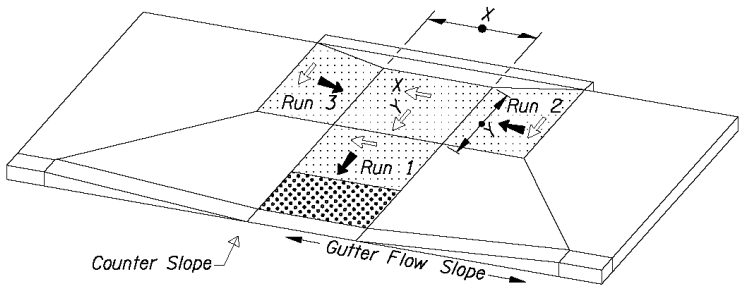

COMBINATION RAMP (C)

???

UNIQUE DESIGN (UD) - take photo

- Pedestrian Access Route (to measure Clear Width)
- Detectable Warning Surface
- Cross Slope (2.0% max.)
- Running Slope (8.3% max.)
- Counter Slope (5.0% max.)
- Turning Space (X & Y) (2.0% max. / 4' x 4' min.)
- Gutter Flow Slope (as directed)

Ramp Style
(PR, PL, C, UD,
EW, CT, BT)


Calibration Date (mm/dd/yy)

RAMP RUN 1	Pass	Fail
Running Slope 1	≤ 8.3%	> 8.3%
Run 1 Length	≤ 15'	> 15'
Cross Slope 1	≤ 2.0%	> 2.0%
Detectable Warning	(TD, X)	(N)
Lip Height	≤ 1/4"	> 1/4"
Gutter Flow Slope		
Curb Running Slope _(avg)	≤ 8.3%	> 8.3%
Counter Slope (+/-)	≤ 5.0%	> 5.0%
Slope Differential		

RAMP RUN 2	Pass	Fail
Running Slope 2	≤ 8.3%	> 8.3%
Run 2 Length	≤ 15'	> 15'
Cross Slope 2	≤ 2.0%	> 2.0%
RAMP RUN 3	Pass	Fail
Running Slope 3	≤ 8.3%	> 8.3%
Run 3 Length	≤ 15'	> 15'
Cross Slope 3	≤ 2.0%	> 2.0%

TURNING SPACE	Pass	Fail
Width X	≥ 4'*	< 4'*
Length Y	and	or
Slope X	≤ 2.0%	> 2.0%
Slope Y		

MISCELLANEOUS	Pass	Fail
Clear Width (feet)	≥ 4'	< 4'
Physical Condition (G,F,P)		
ADA Design Exception (Y,N)		
Design Ex. Control Number		

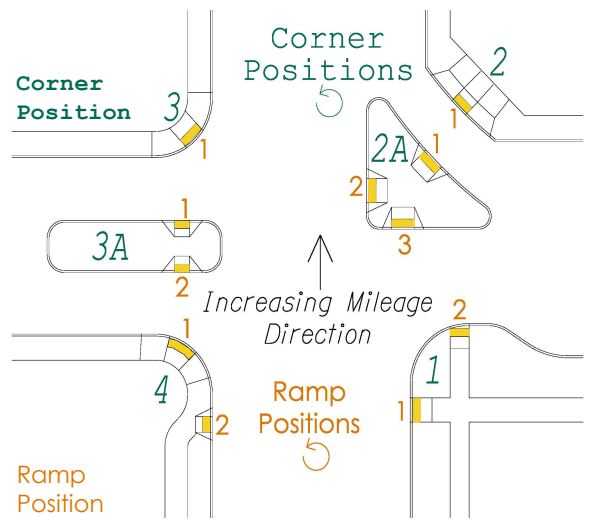

Functional Condition (G,F,P)

Good (G) = all applicable boxes on left pass
 OR Design Exception addresses criteria that do not pass
 Fair (F) = all boxes on left pass, except Detectable Warning
 Poor (P) = any box fails other than Detectable Warning
 See also Standard Drawings RD755 and TM458 to assess provisions not shown: (flares, inlets, alignment, etc.)
 Comment:

Inspector's Signature _____ Date _____

Print name clearly _____ Certification No. _____

Company/Agency _____ Crew No. (ODOT) _____



ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed